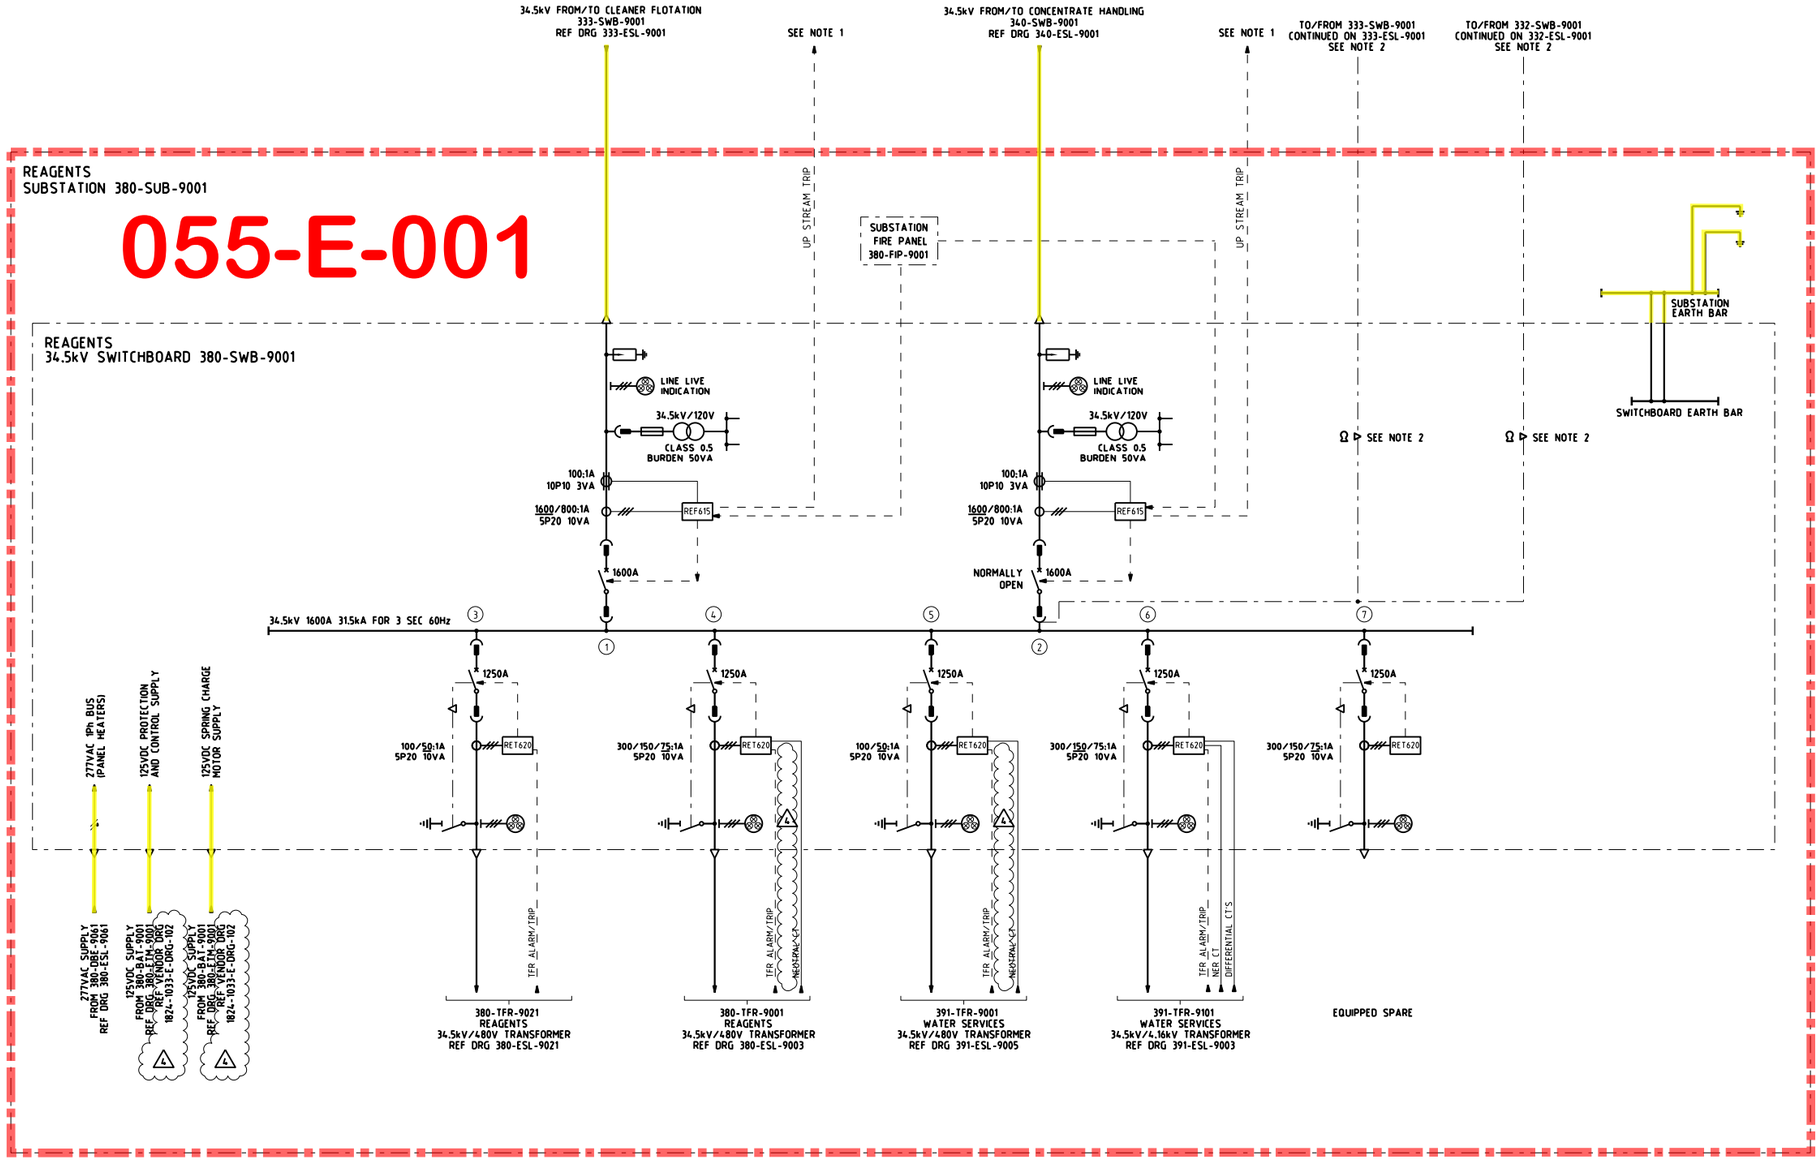


LEGEND

FOR SINGLE LINE DIAGRAM STANDARD SYMBOLS
REF DRG 000-EST-0001

NOTES

1. UPSTREAM BREAKER TO TRIP VIA IEC 61850 GOOSE MESSAGING UPON 'FIRE TRIP'.
2. KEY INTERLOCKING TO PREVENT PARALLELING.

REVISIONS

REV	DESCRIPTION	DRN	CHK	ENG	DATE
3	125VDC & INCOMING SUPPLIES REVISED	JB	KR	GD	21.02.17
2	REVISED AS PER 1824-300-ME-LST-0002/P E/F TOROID DETAILS ADDED	MA	KR	GD	18.11.16
1	REVISED AS PER 1824-300-ME-LST-0002/M	MK	KR	GD	12.08.16
0	ISSUED FOR CONSTRUCTION BASED ON 1824-300-ME-LST-0002/L	MK	AS	GD	28.04.16
4	REVISED AS NOTED	MA	KR	PA	14.02.18

REFERENCE DRAWINGS

DRAWING No.	DESCRIPTION

Process E&I
ABN 53 131 815 337
QUALITY ENGINEERING SOLUTIONS
www.ProcessEI.com.au
Tel: +61 8 9344 6030

DRAWN	M KOCH	28.04.16
CHECKED	A STEINOCHR	28.04.16
DISCIPLINE ENGINEER	G DINGLEY	28.04.16
PRINCIPAL ENGINEER	A DINGLEY	28.04.16
CLIENT	J.R. / K.C.	28.04.16

COPYRIGHT© This drawing remains the property of Process E & I pty ltd.. It shall be used solely for the project for which it has been issued by Process E & I. This drawing shall not be passed on to any electronic format to any third party without prior written approval from Process E & I pty ltd..

MINA DE COBRE PANAMA
REAGENTS
34.5kV SWITCHBOARD 380-SWB-9001
SINGLE LINE DIAGRAM

CLIENT: MINERA PANAMA S.A.

SCALE		DRG. No.	CLIENT PROJECT NUMBER	REV. No.
N.T.S	A0	380-ESL-9001	1824	4

J:\Projects\1824.3 Mina de Cobre Project (1824)\02. Drafting\ESL SLDs\300\380-ESL-9001.dgn 14-Feb-18 4:15:15 PM Myla.Alea